
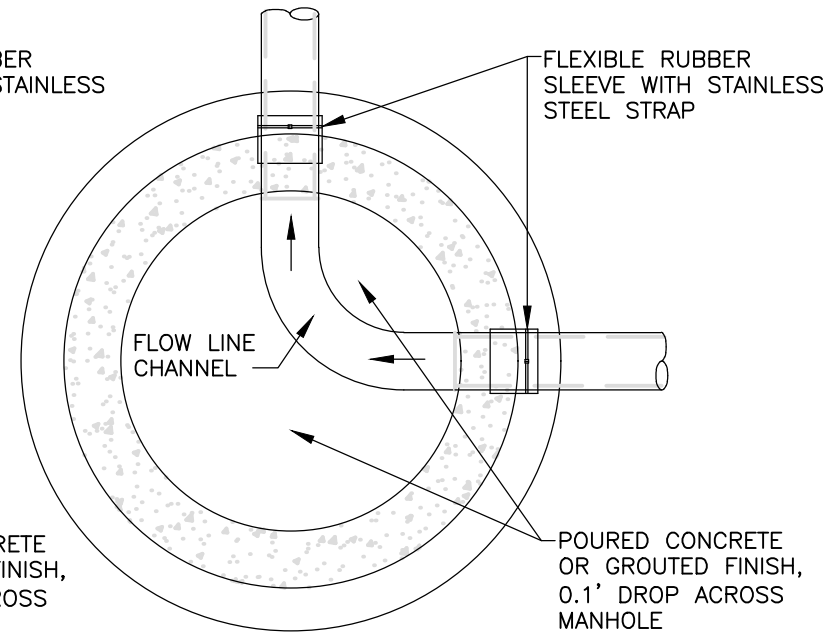


FLOW LINE CHANNELS SHALL BE CLAY BRICK HAVING A MINIMUM OF 2" POURED CONCRETE OR 2" GROUTED 0.1' DROP ACROSS MANHOLE

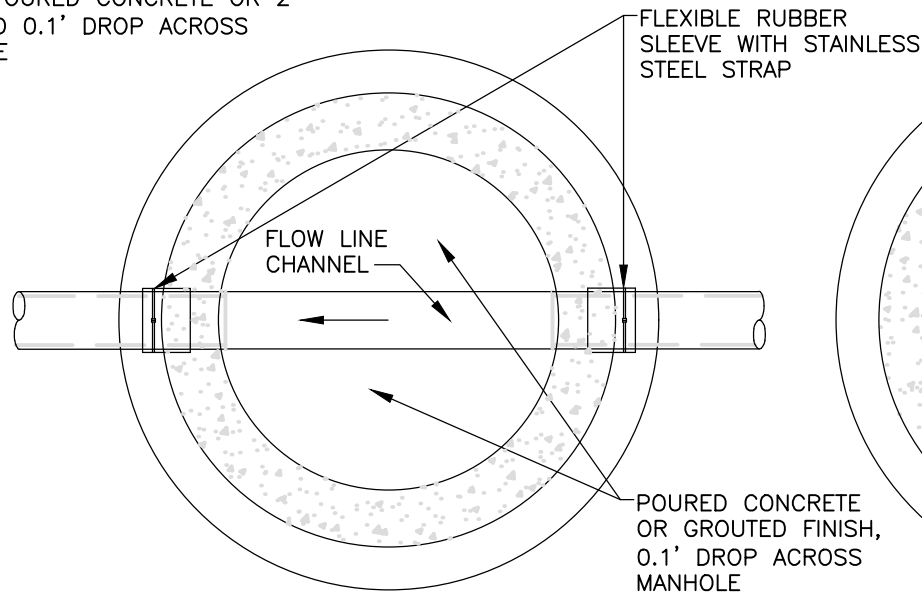

TYPICAL FLOW LINE CHANNELS DETAIL

NTS

REVISION DATE:
APRIL 2006



SHEET NO.
WW-15