



EQUIPMENT SPECIFICATIONS

MARK

- ① DRAWING NOT TO SCALE.
- ② CONTROL PANEL LOCATION AND CONFIGURATION VARIES. REFER TO COUNTY DETAILS WW-8, WW-8A, AND WW-8B FOR DETAILS.
- ③ 120VAC PANELBOARD LOCATED ON EQUIPMENT RACK WITH OTHER PANELS NOT SHOWN. REFER TO COUNTY DETAIL WW-9A FOR COMPLETE EQUIPMENT RACK LAYOUT AND ADDITIONAL PANELBOARD REQUIREMENTS.
- ④ ALL TELECOMMUNICATIONS CONDUIT ENTERING SITE FROM STATION SIDE HANDHOLE SHALL BE SCH 80 PVC UNLESS OTHERWISE NOTED.
- ⑤ REFER TO COUNTY SPECIFICATIONS FOR DETAILED REQUIREMENTS ON MATERIALS OF CONSTRUCTION AND INSTALLATION METHODS.

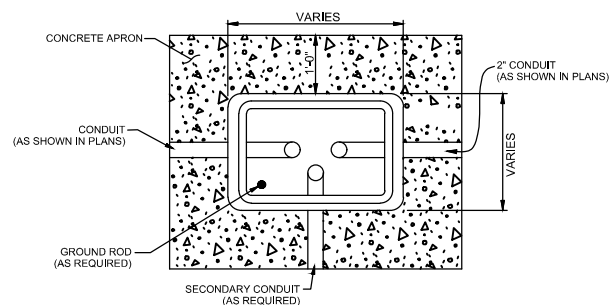


PLAN

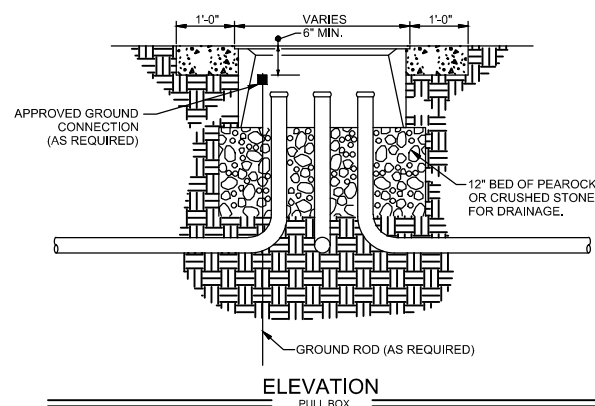

ELEVATION

① DETAIL

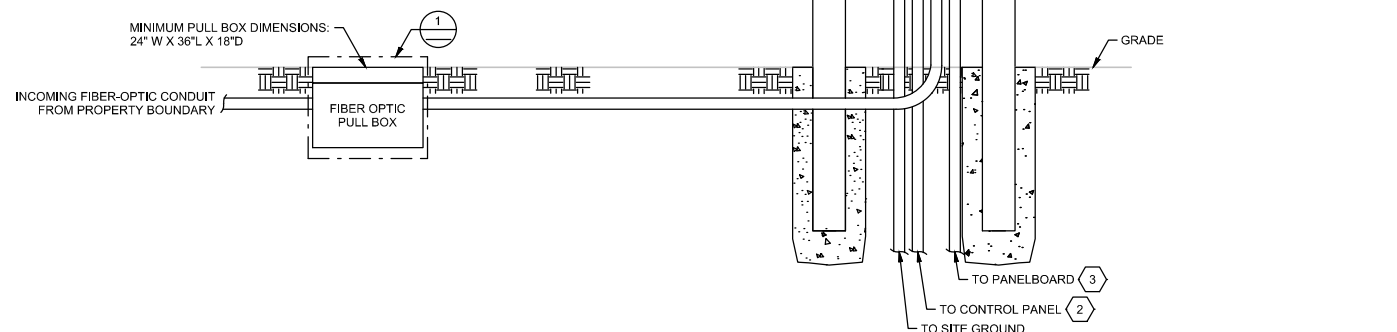

IT FIBER-OPTIC TELECOMMUNICATIONS DETAIL

REVISION DATE:
JANUARY 2025

NTS



SHEET NO.
G-12