



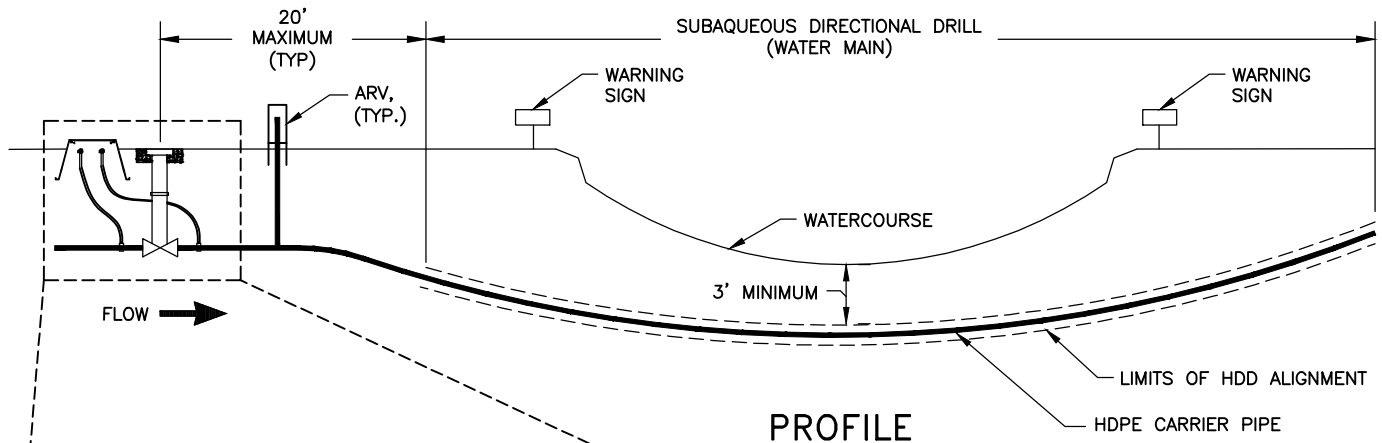

NOTES:

1. WHERE BI-DIRECTIONAL FLOW DOES NOT OCCUR PLACE LEAK DETECTION ASSEMBLY AT UPSTREAM VALVE LOCATION AS SHOWN.
2. PLACE METER BOX AS FAR FROM NEARBY ROADWAY AS PRACTICABLE.

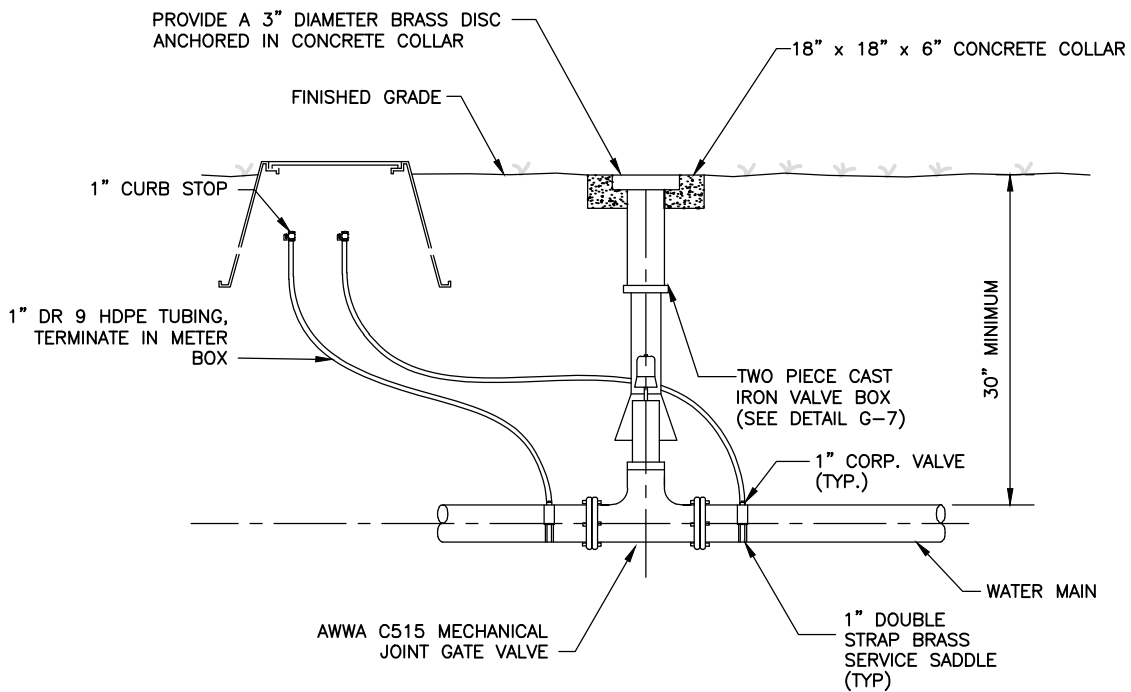

**SUBAQUEOUS WATER MAIN
VALVE DETAIL**

NTS

REVISION DATE:

JULY 2018



Collier County

SHEET NO.

G-9A