


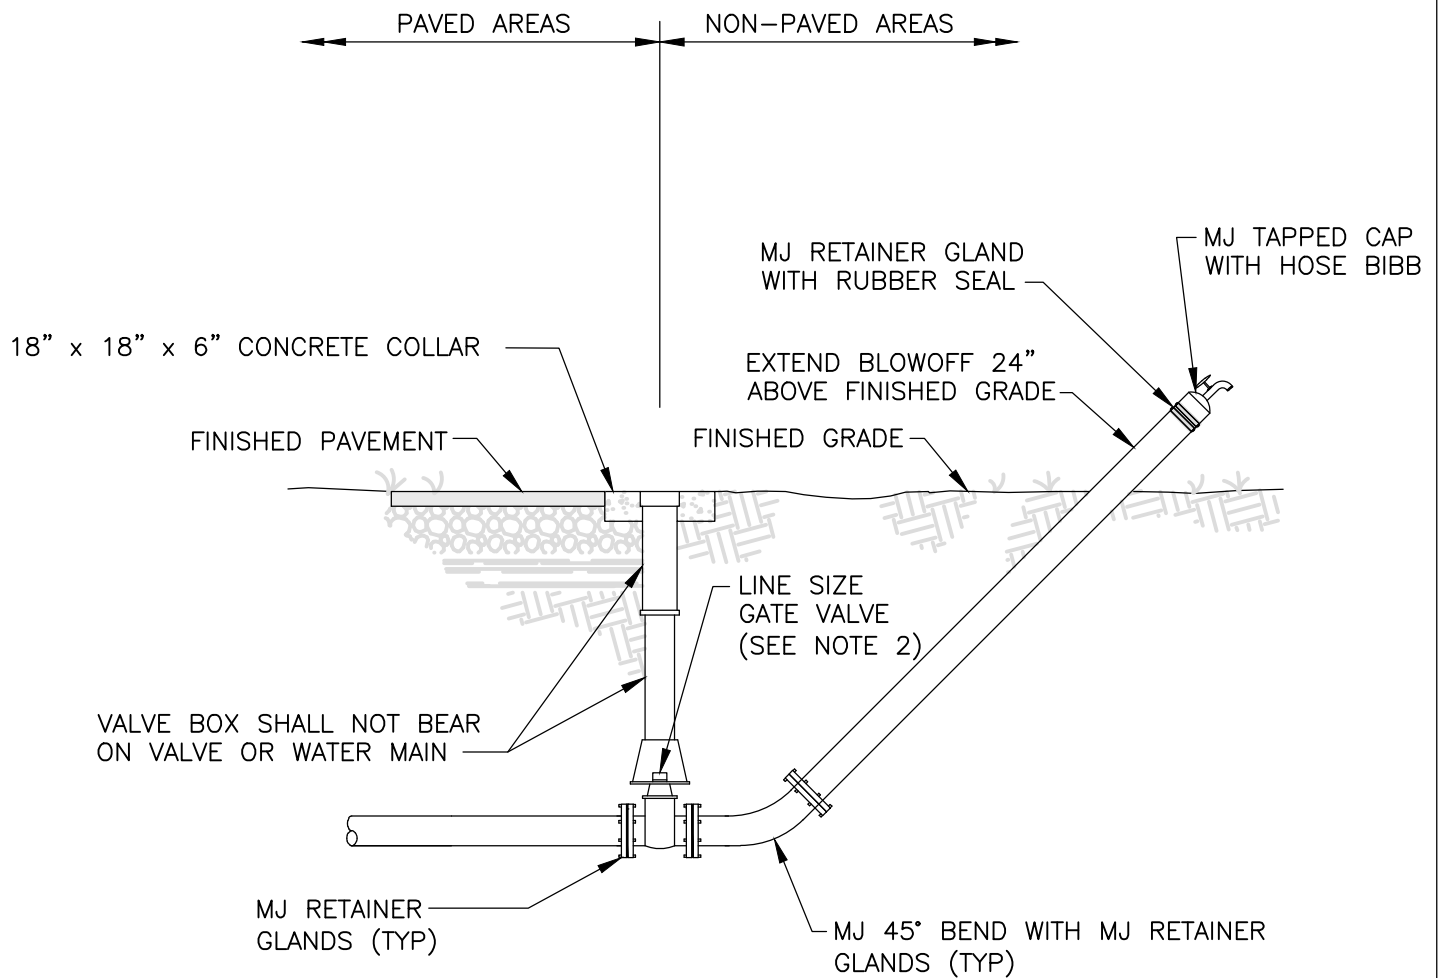

SIDE VIEW

NOTES:

1. MJ TAPPED CAP WITH HOSE BIBB IS TO BE REMOVED AFTER INITIAL BACTERIOLOGICAL CLEARANCE AND PRIOR TO WATER MAIN ACCEPTANCE.
2. SEE TECHNICAL SPECIFICATIONS SECTION 331200 FOR GATE VALVE AND VALVE BOX REQUIREMENTS.
3. ALL COMPONENTS THAT COME INTO CONTACT WITH DRINKING WATER SHALL CONFORM TO NSF STANDARD 61.

**TEMPORARY BLOWOFF
ASSEMBLY WITH BACTERIAL
SAMPLING POINT DETAIL**

NTS

REVISION DATE:
JANUARY 2014



SHEET NO.
W-1